
Janitza®

1





Areas of application

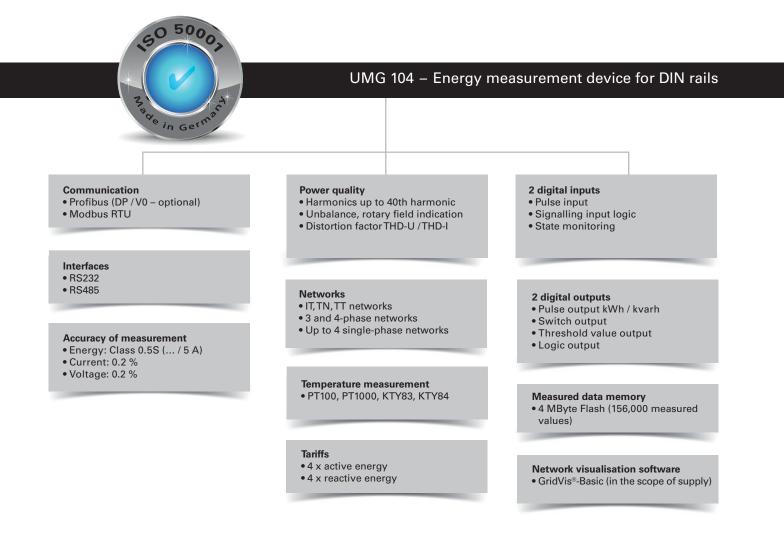

- Consumption data acquisition and evaluation (load profiles, load curves)
- Continuous power quality monitoring
- Cost centre accounting of energy costs
- Network protection
- Measured value transducer for building management systems or PLC

Main features



Power quality

- Harmonics analysis up to 40th harmonic
- Unbalance
- Rotary field indication
- Distortion factor THD-U / THD-I
- Measurement of positive, negative and zero sequence component



Large selection of tariffs

- 4 tariffs for the active energy
- 4 tariffs for the reactive energy
- Drawn active energy: per 4 single-phase; 3-phase total L1–L3 or 4-phase L1–L4
- Inductive reactive energy: per 4 single-phase;
 3-phase total L1–L3 or 4-phase L1–L4
- Differentiation of drawn and delivered active energy



High-speed Modbus

- Fast and reliable data exchange via RS485 interface
- Speed up to 921.6 kB/s

Secure and rapid communication via Modbus and Profibus

- Rapid, cost-optimised and reliable communication in existing Fieldbus architectures
- Integration in PLC systems and building management systems
- High flexibility due to the use of open standards






Fig.: GridVis® – Phasor diagram




Fig.: High-speed Modbus

² Janitza[®]



Large measurement data memory

• 4 MByte

- 156,000 saved values
- Recording range dependent on the user-defined measurement data memory configuration over a few months
- Recording freely configurable

Added value through additional functions


The UMG 104 goes far beyond the limits of digital multifunction measurement devices thanks to the integration of additional functions:


- Multifunction measurement device
- State monitoring
- Data logger
- Meters (kWh, kvarh)
- •Temperature monitoring
- Harmonics analyser

Due to the four current and voltage inputs there are also particular advantages with the monitoring of up to four singlephase outputs, e.g. in data centres, offices or single-phase motor outputs.

||||||| 1 2 3

Dimension diagrams





Front view





Fig.: Large measurement data memory



Typical connection



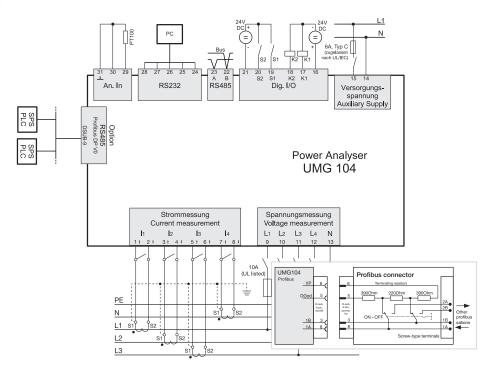

Device overview and technical data

	UMG 104			UMG 104P	
Item number	52.20.001	52.20.003	52.20.005	52.20.002	52.20.006
Item number (UL)	52.20.201	-	-	52.20.202	-
Supply voltage AC	95 240 V AC	50 110 V AC	20 55 V AC	95 240 V AC	20 55 V AC
Supply voltage DC	135 340 V DC	50 155 V DC	20 77 V DC	135 340 V DC	20 77 V DC
Communication					
Interfaces					
RS485: 9.6 – 921.6 kbps (Screw-type terminal)	•	•	•	•	•
RS232: 9.6 – 115.2 kbps (Screw-type terminal)	•	•	•	•	•
Profibus DP: Up to 12 Mbps (DSUB-9-socket)	-	-	-	•	•

General	
Use in low and medium voltage networks	•
Accuracy voltage measurement	0.2 %
Accuracy current measurement	0.2 %
Accuracy active energy (kWh,/5 A)	Class 0.5S
Number of measurement points per period	400
Uninterrupted measurement	•
RMS - momentary value	
Current, voltage, frequency	•
Active, reactive and apparent power / total and per phase	•
Power factor / total and per phase	•

Comment: For detailed technical information please refer to the operation manual and the Modbus address list.

• = included -= not included

An RS232 connecting cable is not included in the delivery and must be ordered separately as item no. 08.02.427.




Fig.: Profibus connector, contact allocation




Fig.: Word-wide remote monitoring of the energy consumption and temperature for various different locations

Comment: For detailed technical information please refer to the operation manual and the Modbus address list.

• = included - = not included

*1 Optional additional functions with the packages GridVis®-Professional, GridVis®-Enterprise and GridVis®-Service.

Energy measurement Active, reactive and apparent energy [L1,L2,L3, L4,	•	
Number of tariffs	8	
Recording of the mean values	0	
Voltage, current / actual and maximum	•	
Active, reactive and apparent power / actual and m	•	
Frequency / actual and maximum	•	
Demand calculation mode (bi-metallic function) / th	•	
Other measurements		
Clock		•
Power quality measurements		
Harmonics per order / current and voltage	1st – 40th	
Harmonics per order / active and reactive power	1st – 40th	
Distortion factor THD-U in %	•	
Distortion factor THD-I in %	•	
Voltage unbalance		•
Rotary field indication		•
Current and voltage, positive, zero and negative se	quence component	•
Measured data recording		
Memory (Flash)		4 MB
Average, minimum, maximum values		•
Measured data channels		4
Alarm messages		•
Time stamp		•
Time basis average value RMS averaging, arithmetic		freely user-defined
		•
Displays and inputs / outputs LCD display		•
Digital inputs		2
Digital outputs (as switch or pulse output)		2
Thermistor input (PT100, PT1000, KTY83, KTY84)		•
Voltage and current inputs		every 4
Password protection		•
Communication		
Protocols		
Modbus RTU		•/•
Profibus DP V0	-/•	
Software GridVis [®] -Basic ^{*1}		
Online graphs		•
Online graphs Databases (Janitza DB, Derby DB); MySQL, MS SQL w	vith higher GridVis® versions)	•
	vith higher GridVis® versions)	• • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w	vith higher GridVis® versions)	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality)	vith higher GridVis® versions)	• • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views	vith higher GridVis® versions)	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices		• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets		• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySOL, MS SOL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage		• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manag Comparator (2 Groups with 4 comparators each) Technical data	gement Constant true RMS	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement	gement Constant true RMS Up to 40th harmonic	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (LN, LL)	Constant true RMS Up to 40th harmonic 277 / 480 V AC	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-N, L-L)	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4	• • • • • • • • • • • • • • • • • • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 4-conductor (L-N, L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 4-conductor (L-N, L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage L-N, AC	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 4-conductor (L-N, L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category	Gement Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III 10 600 Vrms	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage L-N, AC (without potential transformer)	constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (LN, LL) Nominal voltage, three-phase, 3-conductor (LL) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage LN, AC (without potential transformer) Measured range, voltage LL, AC	Gement Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III 10 600 Vrms	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage L-N, AC (without potential transformer) Measured range, voltage LL, AC (without potential transformer)	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III 10 600 Vrms 18 1,000 Vrms	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage L-N, AC (without potential transformer) Measured range, voltage L-L, AC (without potential transformer) Resolution Impedance Frequency measuring range	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III 10 600 Vrms 18 1,000 Vrms 0.01 V	• • • •
Databases (Janitza DB, Derby DB); MySQL, MS SQL w Manual reports (energy, power quality) Topology views Manual read-out of the measuring devices Graph sets Programming / threshold values / alarm manage Comparator (2 Groups with 4 comparators each) Technical data Type of measurement Nominal voltage, three-phase, 4-conductor (L-N, L-L) Nominal voltage, three-phase, 3-conductor (L-L) Measurement in quadrants Networks Measurement in single-phase / multi-phase networks Measured voltage input Overvoltage category Measured range, voltage L-N, AC (without potential transformer) Measured range, voltage L-L, AC (without potential transformer) Resolution Impedance	Constant true RMS Up to 40th harmonic 277 / 480 V AC 480 V AC 4 TN, TT, IT 1 ph, 2 ph, 3 ph, 4 ph and up 300 V CAT III 10 600 Vrms 18 1,000 Vrms 0.01 V 4 MOhm / phase	• • • • • • to 4 times 1 ph



Macoured auront input		
Measured current input Rated current	1/5A	
Resolution	1 mA	
Measurement range	0.001 8.5 Amps	
Overvoltage category	300 V CAT III	
Measurement surge voltage	4 kV	
Power consumption	approx. 0.2 VA (Ri = 5 MOhm)	
Overload for 1 sec.	100 A (sinusoidal)	
Sampling frequency	20 kHz	
Digital inputs and outputs		
Number of digital inputs	2	
Maximum counting frequency	20 Hz	
Input signal present	18 28 V DC (typical 4 mA)	
Input signal not present	0 5 V DC, current < 0.5 mA	
Number of digital outputs	2	
Switching voltage	max. 60 V DC, 30 V AC	
Switching current	max. 50 mA Eff AC / DC	
Pulse output (energy pulse)	max. 20 Hz	
	up to 30 m unscreened,	
Maximum cable length	from 30 m screened	
Mechanical properties		
Weight	350 g	
Device dimensions in mm (H x W x D)	90 x 107.5 x approx. 82	
Battery	Type Lithium CR2032, 3 V	
Protection class per EN 60529	IP20	
Assembly per IEC EN 60999-1 / DIN EN 50022	35-mm DIN rail	
Connecting phase (U / I),		
Single core, multi-core, fine-stranded	0.08 to 2.5 mm ²	
Terminal pins, core end sheath	1.5 mm ²	
Environmental conditions		
Temperature range	Operation: K55 (-10 +55 °C)	
Relative humidity	Operation: 5 to 95 % (at 25 °C)	
Operating height	0 2,000 m above sea level	
Degree of pollution	2	
Installation position	user-defined	
Electromagnetic compatibility		
Electromagnetic compatibility of electrical equipment	Directive 2004/108/EC	
Electrical appliances for application within		
particular voltage limits	Directive 2006/95/EC	
Equipment safety		
Safety requirements for electrical		
equipment for measurement, regulation, control	IEC/EN 61010-1	
and laboratory use – Part 1: General requirements		
Part 2-030: Particular requirements for		
testing and measuring circuits	IEC/EN 61010-2-030	
Noise immunity		
Industrial environment	IEC/EN 61326-1	
Electrostatic discharge	IEC/EN 61000-4-2	
Voltage dips	IEC/EN 61000-4-11	
Emissions		
Class B: Residential environment	IEC/EN 61326-1	
Radio disturbanc voltage strength 30 – 1000 MHz	IEC/CISPR11/EN 55011	
Radiated interference voltage 0.15 – 30 MHz	IEC/CISPR11/EN 55011	
Safety		
Europe	CE labelling	
USA and Canada	UL variants available	
Firmware		
	Update via GridVis [®] software.	
Firmware update	Firmware download (free of charge) from the website:	
	http://www.janitza.com/downloads/	

Comment: For detailed technical information please refer to the operation manual and the Modbus address list.

• = included - = not included

Janitza electronics GmbH Vor dem Polstück 1 D-35633 Lahnau Germany

Tel.: +49 6441 9642-0 Fax: +49 6441 9642-30 info@janitza.de www.janitza.com



Version 01/2015 • Subject to technical alterations.

